



DIRECTIVE #2022-01

DATE: October 14, 2022

TO: Director of Planning
Director of Building & Code
Public Works Director
Public Utilities Director
Subdivision Planner II
Fire Chief
Director of Innovation & Technology

FROM: Ruben Alfaro, P.E. – City Engineer RA

SUBJECT: FIRE HYDRANT ALUMINUM COATING

This Directive will serve as Official Notice to all staff involved in the building permit review process of the additional requirements for fire hydrant.

This DIRECTIVES will modify as follows:

Section IV - 3.A.11


All buildings in the City Limits (and ETJ developments) shall be within 500 feet of a standard city fire hydrant. The contractor is responsible for painting all installed fire hydrants with a finish coat of Caution Yellow "Sherwin Williams Corothane I Mio Aluminum" or an equal finish coating- or as designated approved by the Fire Department.

Section IV - 3.C.8

Fire Hydrants shall be of the brand Mueller, American Darling or Kennedy provided with a standard coating from the manufacturer and painted "caution" yellow, oil based paint, and finished with a coating of aluminum as noted in Section IV – 3.A.11.

Standard Detail WTR-2

FIRE HYDRANT (MUELLER, AMERICAN DARLING AND KENNEDY)PROVIDED WITH A STANDARD COATING FROM THE MANUFACTURER AND FINISHED WITH A COATING OF ALUMINUM AS NOTED IN SECTION IV – 3.A.11 ~~PAINTED CAUTION YELLOW WITH~~)

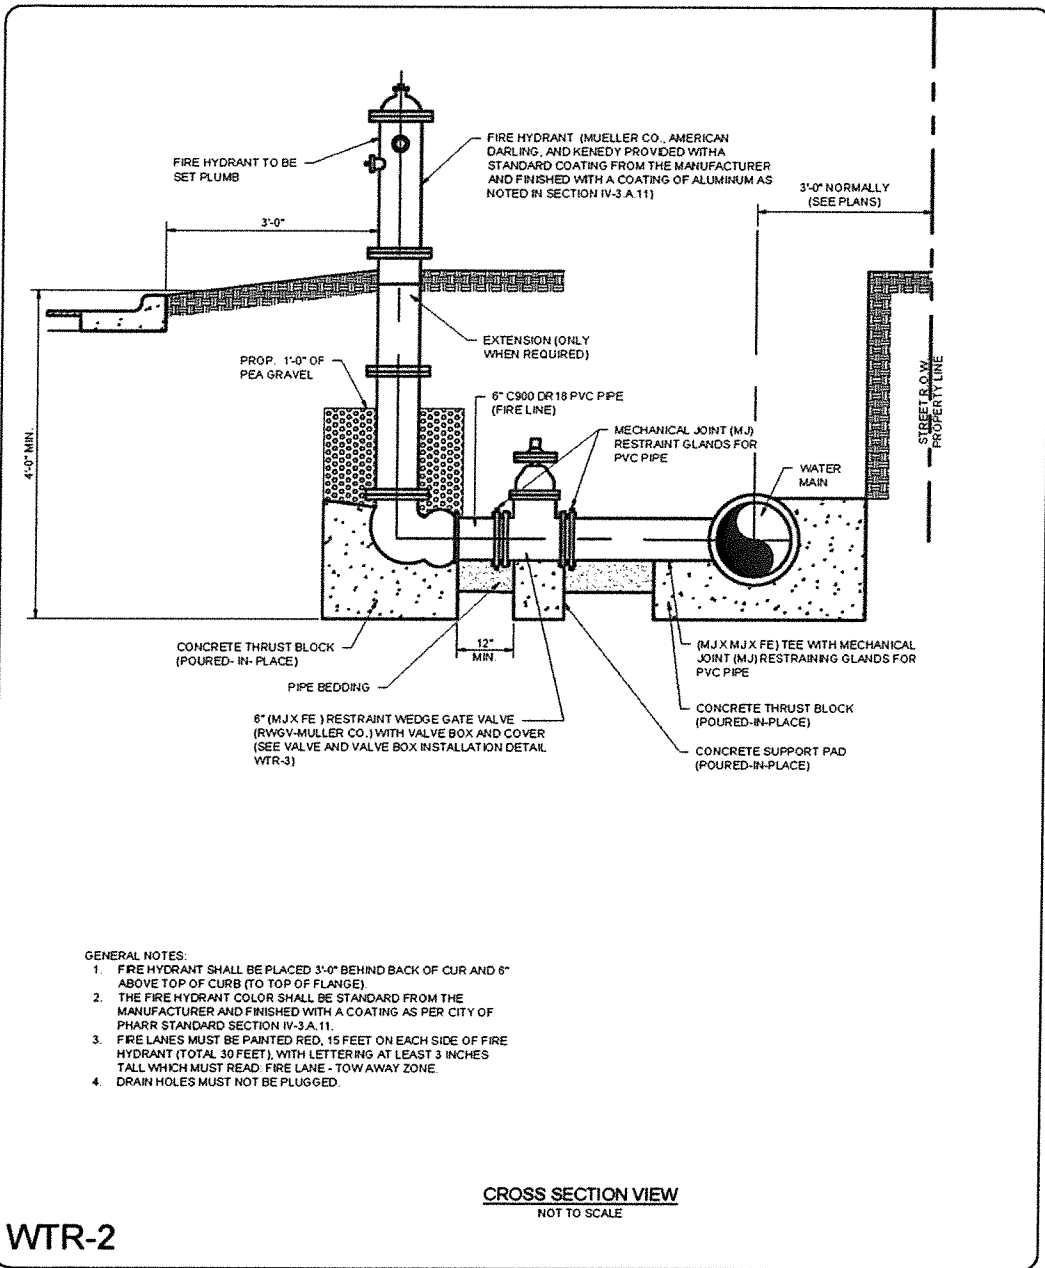

FIRE HYDRANT DETAILS	DESIGNED BY:	DESIGNER	Pharr Engineering 118 S Cage Blvd. Pharr, TX 78577 956-402-4221
	DRAWN BY:	DRAWN_BY	
	CHECKED BY:	CKD_BY	
	DATE:	DATE	

This DIRECTIVE will go into effect immediately and it will be enforced until a new updated standard is in effect.

END OF DIRECTIVE